


PROJECT ADDRESS:

DECK BY:

CHECK LIST

- Exterior wood will be naturally durable or quality mark as pressure-preservative-treated in accordance with AWPA U1.
- **Fasteners** will be hot dipped zinc-coated galvanized steel, stainless steel, silicon bronze or copper.
- 36" minimum Guard will be provided along open-sides of deck walking surface located 30" or more above Grade below.
- 4" Sphere will not pass thru any guard openings.

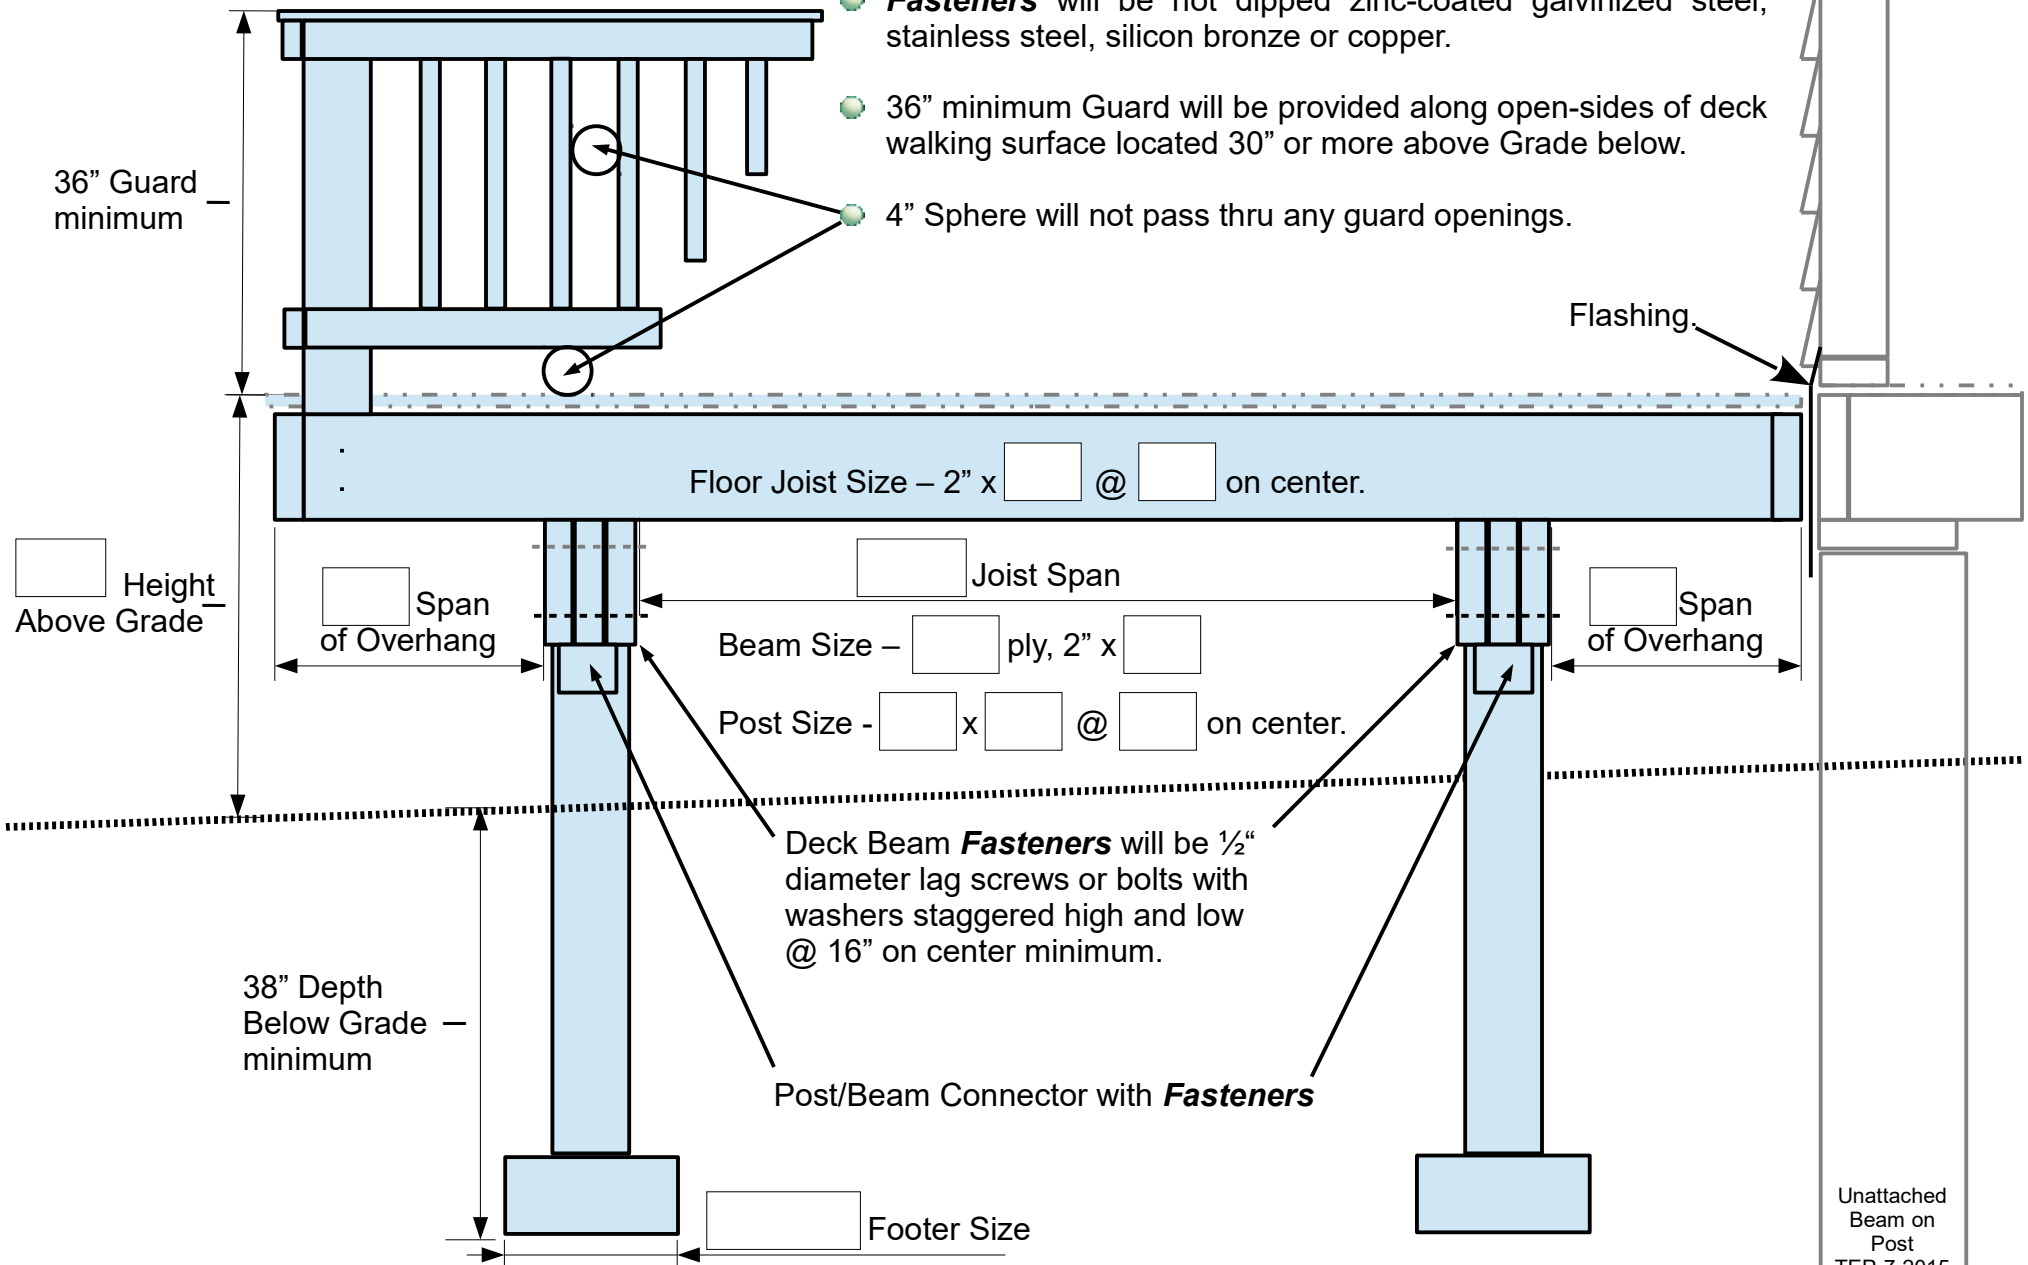

Height Above Grade

Span of Overhang

Joist Span

Span of Overhang

Beam Size - ply, 2" x

Post Size - x @ on center.

Deck Beam **Fasteners** will be 1/2" diameter lag screws or bolts with washers staggered high and low @ 16" on center minimum.

Post/Beam Connector with **Fasteners**

38" Depth Below Grade - minimum

Footer Size

Flashing